


| Qty.              | Description  |  |  |  |  |  |
|-------------------|--|--|--|--|--|--|
| α <b>ιγ.</b><br>1 | HYDRO MULTI-E 3 CRIE 3-5   |  |  |  |  |  |
| I                 |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | Note! Product picture may differ from actual product Product No.: 98486631   |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | GRUNDFOS Hydro Multi-E booster sets are designed for the transfer and pressure boosting of clean water in  |  |  |  |  |  |
|                   | waterworks, blocks of flats, hotels, industry, hospitals, schools, etc.  |  |  |  |  |  |
|                   | GRUNDFOS Hydro Multi-E booster set consists of 2 to 4 CRIE pumps coupled in parallel and mounted on a common base frame provided with all the necessary fittings.  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | Hydro Multi-E is mounted on a common base frame made of stainless steel (DIN WNr. 1.4301).   |  |  |  |  |  |
|                   | On the suction side are fitted a suction manifold (DIN WNr.  |  |  |  |  |  |
|                   | 1.4401 or DIN WNr.   |  |  |  |  |  |
|                   | 1.4571) , a pressure switch mounted on a drainable valve and an isolating valve.<br>On the discharge side of the pumps are fitted a non-return valve, an isolating valve, a pressure gauge, two pressure |  |  |  |  |  |
|                   | transmitters mounted on a drainable valve a diaphragm tank and a stainless steel discharge manifold (DIN WNr.  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | 1.4401 or DIN WNr.   |  |  |  |  |  |
|                   | 1.4571).<br>The Hydro Multi-E is fitted with an on/off-switch for the supply voltage.  |  |  |  |  |  |
|                   | The right multi-L is filled with an on/on-switch for the supply voltage.   |  |  |  |  |  |
|                   | The Hydro Multi-E is designed for maintaining a constant pressure regardless of flow changes and fluctuation.  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | The internal PI-controller regulates the number of running pumps and the speed of the pumps according to the required flow.  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | The system can be operated directly on the panel of any of the pumps or via Grundfos GO (available as accessory)   |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | Besides the system features:   |  |  |  |  |  |
|                   | 2 Digital outputs  |  |  |  |  |  |
|                   | 2 Digital inputs (one used for dry run protection)   |  |  |  |  |  |
|                   | 2 Analogue inputs (one used for discharge pressure sensor)   |  |  |  |  |  |
|                   | Multi-Master functionality<br>2 Limit functions  |  |  |  |  |  |
|                   | Set-point influence function   |  |  |  |  |  |
|                   | Pipe filling function  |  |  |  |  |  |
|                   | High efficient PM motors   |  |  |  |  |  |
|                   | Available communication protocols:   |  |  |  |  |  |
|                   | •LON   |  |  |  |  |  |
|                   | •Profibus  |  |  |  |  |  |
|                   | •Modbus  |  |  |  |  |  |
|                   | •SMS/GSM/GPRS  |  |  |  |  |  |
|                   | •GRM<br>•BACnet  |  |  |  |  |  |
|                   | •BACnet IP   |  |  |  |  |  |
|                   | •Modbus TCP  |  |  |  |  |  |
|                   | •PROFINET  |  |  |  |  |  |
|                   | When delivered, the GPUNDEOS Hydro Multi E boostor sot is factory tested and ready for operation   |  |  |  |  |  |
|                   | When delivered, the GRUNDFOS Hydro Multi-E booster set is factory tested and ready for operation.  |  |  |  |  |  |
|                   |  |  |  |  |  |  |
|                   | Liquid:  |  |  |  |  |  |
|                   | Pumped liquid: Water   |  |  |  |  |  |
|                   |  |  |  |  |  |  |


| Qty. | Description  |   |
|------|--|---|
| 1    | Liquid temperature range:<br>Selected liquid temperature:<br>Density:  | 5 60 °C<br>20 °C<br>998.2 kg/m³   |
|      | Technical:<br>Max flow:  | 16.2 m³/h   |
|      | Materials:<br>Pump housing:  | Stainless steel   |
|      | Installation:<br>Maximum operating pressure:<br>Maximum permissible inlet press<br>Flange standard:<br>Manifold inlet:<br>Manifold outlet:   | 10 bar<br>ure: PN 10 bar<br>DIN ISO 7/1<br>R 2<br>R 2                                 |
|      | Electrical data:<br>IE Efficiency class:<br>Power (P2) main pump:<br>Mains frequency:<br>Rated voltage:<br>Phase main pump:<br>Rated current:<br>Start. method:<br>Enclosure class (IEC 34-5): | IE5<br>0.75 kW<br>50 / 60 Hz<br>3 x 380-415 V<br>1<br>7.1 A<br>electronically<br>IP54 |
|      | Tank:<br>Volume of pressure tank:<br>Diaphragm tank:   | 8 I<br>Yes  |
|      | Others:<br>Net weight:<br>Gross weight:<br>Shipping volume:<br>Language:<br>Danish VVS No.:<br>Country of origin:<br>Custom tariff no.:  | 116 kg<br>125 kg<br>0.403 m <sup>3</sup><br>GB<br>385552535<br>GB<br>84137075         |
|      |  |   |
|      |  |   |
|      |  |   |
|      |  |   |

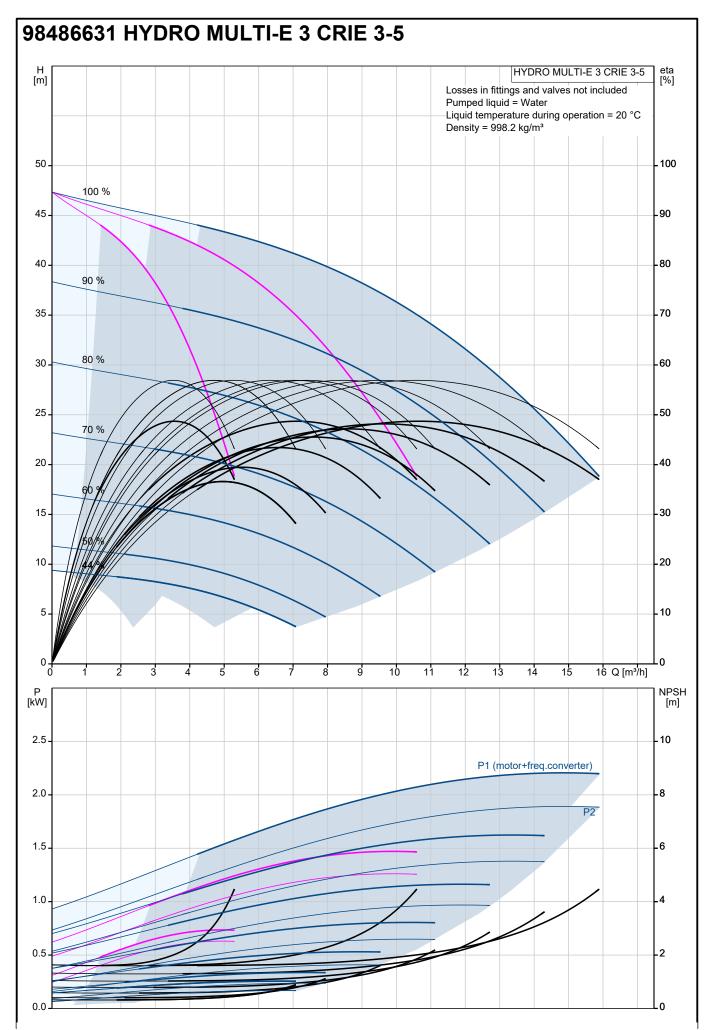



| Description                            | Value                  |  |  |  |  |
|--|------------------------|--|--|--|--|
| Description<br>General information:    | value                  |  |  |  |  |
| Product name: HYDRO MULTI-E 3 CRIE 3-5 |                        |  |  |  |  |
| Floduct hame.                          |                        |  |  |  |  |
| Product No:                            | 98486631               |  |  |  |  |
| EAN number:                            | 5711495952976          |  |  |  |  |
| Technical:                             |                        |  |  |  |  |
| Max flow:                              | 16.2 m³/h              |  |  |  |  |
| Min flow system:                       | 0.35 m³/h              |  |  |  |  |
| Head max:                              | 47 m                   |  |  |  |  |
| Pump name:                             | CRIE 3-5               |  |  |  |  |
| Number of pumps:                       | 3                      |  |  |  |  |
| Materials:                             |                        |  |  |  |  |
| Pump housing:                          | Stainless steel        |  |  |  |  |
| Manifolds:                             | Stainless steel        |  |  |  |  |
| Installation:                          | 10 h an                |  |  |  |  |
| Maximum operating pressure:            | 10 bar                 |  |  |  |  |
| Maximum permissible inlet pressure:    | PN 10 bar              |  |  |  |  |
| Flange standard:                       | DIN ISO 7/1            |  |  |  |  |
| Manifold inlet:                        | R 2                    |  |  |  |  |
| Manifold outlet:                       | R 2                    |  |  |  |  |
| Liquid:                                |                        |  |  |  |  |
| Pumped liquid:                         | Water                  |  |  |  |  |
| Liquid temperature range:              | 5 60 °C                |  |  |  |  |
| Selected liquid temperature:           | 20 °C                  |  |  |  |  |
| Density:                               | 998.2 kg/m³            |  |  |  |  |
| Electrical data:                       |                        |  |  |  |  |
| IE Efficiency class:                   | IE5                    |  |  |  |  |
| Power (P2) main pump:                  | 0.75 kW                |  |  |  |  |
| Mains frequency:                       | 50 / 60 Hz             |  |  |  |  |
| Rated voltage:                         | 3 x 380-415 V<br>1     |  |  |  |  |
| Phase main pump:                       | •                      |  |  |  |  |
| Rated current:<br>Start_method:        | 7.1 A                  |  |  |  |  |
|  | electronically<br>IP54 |  |  |  |  |
| Enclosure class (IEC 34-5):<br>Tank:   | IF 34                  |  |  |  |  |
| Volume of pressure tank:               | 81                     |  |  |  |  |
| Diaphragm tank:                        | Yes                    |  |  |  |  |
| Others:                                |                        |  |  |  |  |
| Net weight:                            | 116 kg                 |  |  |  |  |
| Gross weight:                          | 125 kg                 |  |  |  |  |
| Shipping volume:                       | 0.403 m <sup>3</sup>   |  |  |  |  |
| Language:                              | GB                     |  |  |  |  |
| Danish VVS No.:                        | 385552535              |  |  |  |  |
| Country of origin:                     | GB                     |  |  |  |  |
| Custom tariff no.:                     | 84137075               |  |  |  |  |
|  |                        |  |  |  |  |

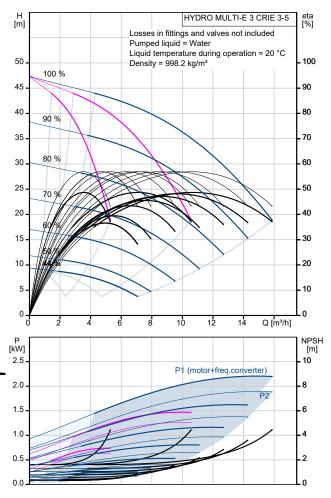









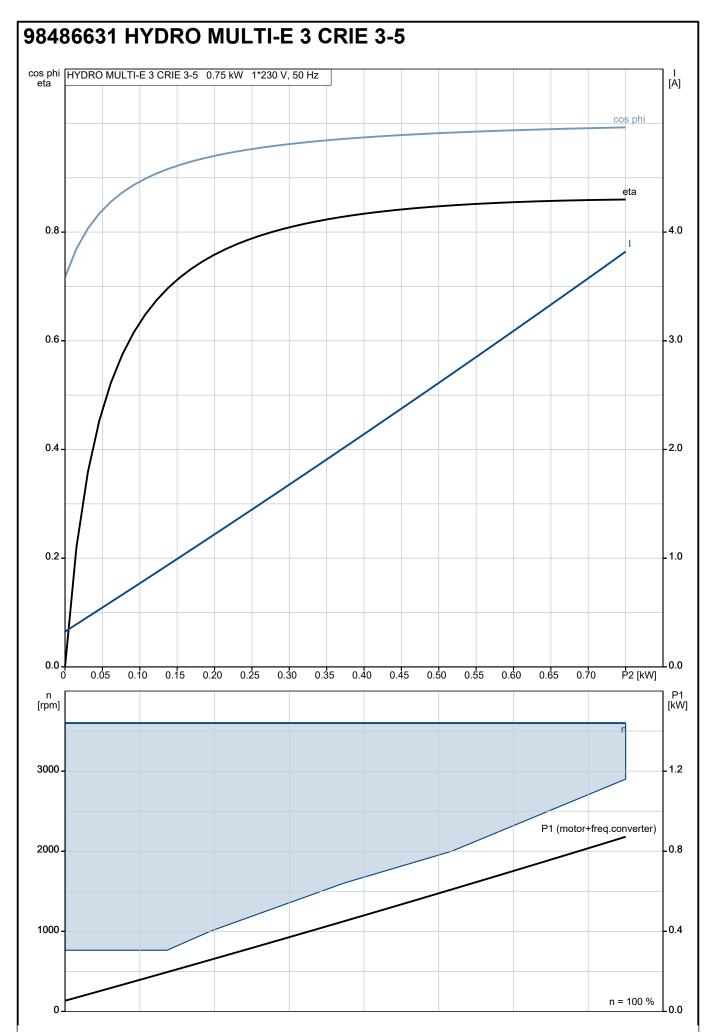


## 98486631 HYDRO MULTI-E 3 CRIE 3-5

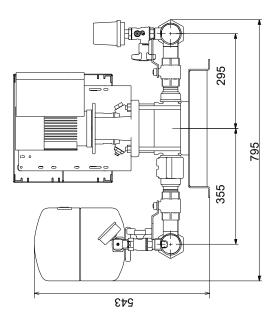

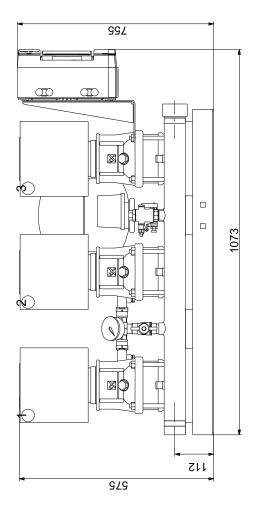

Note! All units are in [mm] unless others are stated. Disclaimer: This simplified dimensional drawing does not show all details.

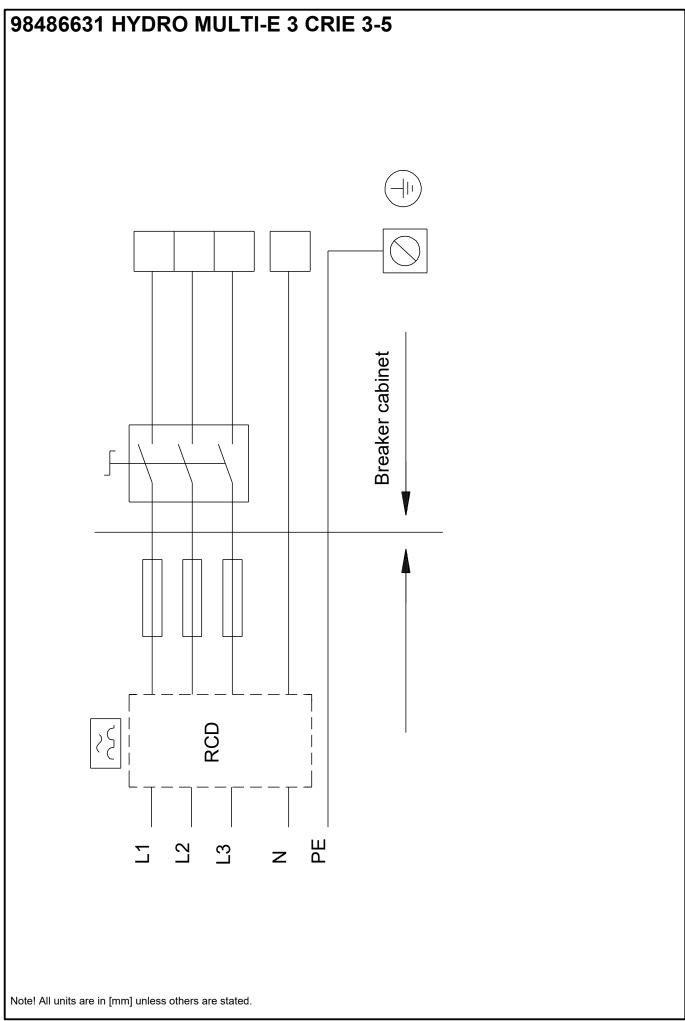

| Order Data: |           |                          |        |            |                    |  |  |  |
|-------------|-----------|--------------------------|--------|------------|--------------------|--|--|--|
| Position    | Your pos. | Product name             | Amount | Product No | Total              |  |  |  |
|             |           | HYDRO MULTI-E 3 CRIE 3-5 | 1      | 98486631   | Price or<br>reques |  |  |  |
|             |           |                          |        |            | Teques             |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |
|             |           |                          |        |            |                    |  |  |  |